


SAGINAW CONTROL & ENGINEERING

SCE-DFJ1008



"X" MINIMUM WHEN INSTALLED IN...
ELJ ENCLOSURE = 1.50
CH ENCLOSURE = 0.75
NEMA-1 ENCLOSURE = 1.50

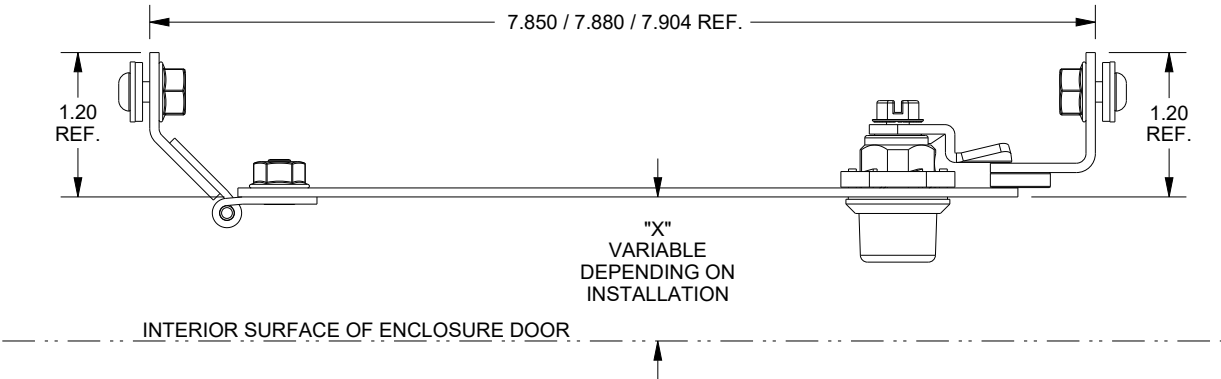